

# THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

## Search Parameters

Manufacturer

Holdrite

## XHEZ - Through-penetration Firestop Systems

### XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

### System No. C-AJ-2847

January 08, 2019

ANSI/UL1479 (ASTM E814)	CAN/ULC S115	
F Rating — 2 Hr	F Rating — 2 Hr	
T Rating — 2 Hr	FT Rating — 2 Hr	
	FH Rating — 2 Hr	
	FTH Rating — 2 Hr	

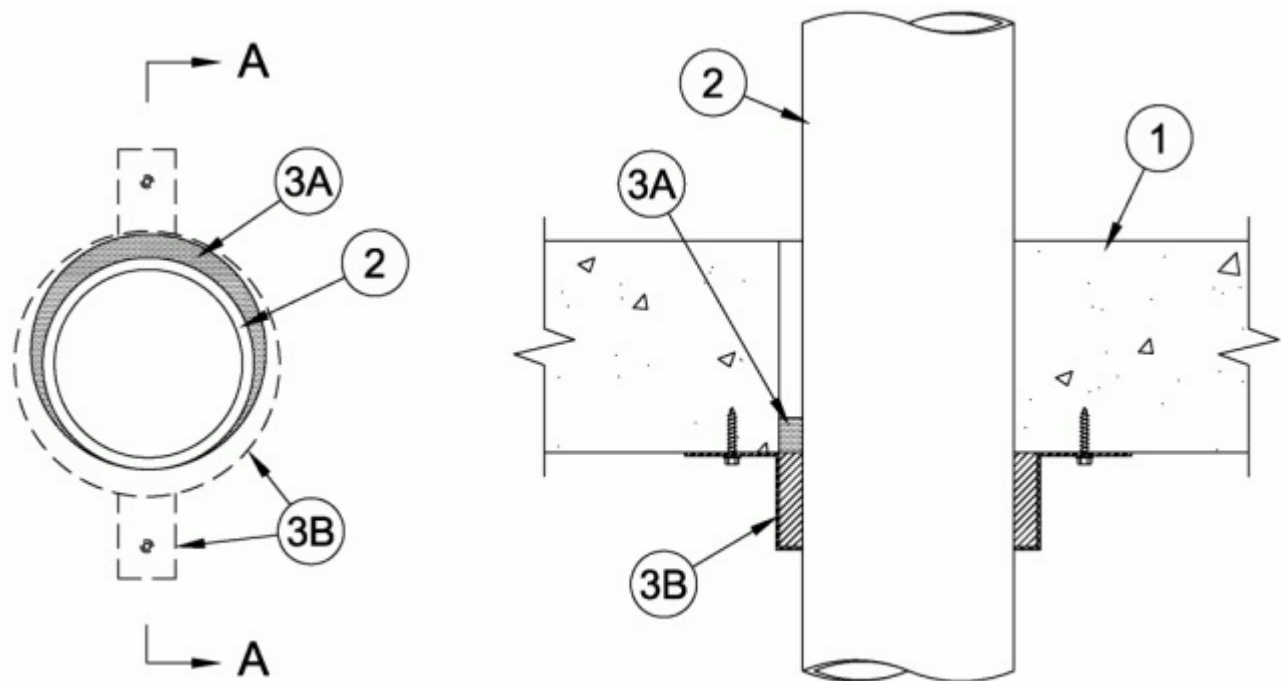

Section A-A

**System tested with a pressure differential of 2.5 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.**

**1. Floor or Wall Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks\***. Floor may also be constructed of any min 6 in. (152 mm) thick UL Classified hollow-core **Precast Concrete Units\***. Opening to be max 5/8 in. (16 mm) larger than outside diam of nonmetallic pipe. Max diam of opening is 4 in. (102 mm).

See **Concrete Blocks(CAZT)** and **Precast Concrete Units (CFTV)** categories in the Fire Resistance Directory for names or manufacturers.

**2. Nonmetallic Pipe** — Nom 3 in. (76 mm) diam (or smaller) nonmetallic pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems. Pipe to be installed either concentrically or eccentrically within the firestop system. The annular space between the pipe and periphery of opening shall be min 0 in. (point contact) to max 1/2 in. (13 mm). Pipe to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of nonmetallic pipe may be used:

**A. Polypropylene (PP) Pipe** — Nom 3 in. (76 mm) diam (or smaller) Aquatherm Greenpipe SDR 7.4 with Faser PP pipe for use in closed (process or supply) or vented (drain, waste and vent) piping systems.

**B. Polypropylene (PP) Pipe** — Nom 2 in. (51 mm) diam (or smaller) Aquatherm Greenpipe SDR 11 PP pipe for use in closed

(process or supply) or vented (drain, waste and vent) piping systems.

C. **Polypropylene (PP) Pipe** — Nom 3 in. (76 mm) diam (or smaller) Aquatherm Climatherm SDR 11 with Faser PP pipe for use in closed (process or supply) or vented (drain, waste and vent) piping systems.

3. **Firestop System** — The firestop system shall consist of the following:

A. **Fill, Void or Cavity Materials \* - Caulk** — Min 1/2 in. (13 mm) thickness of caulk applied within annulus, flush with bottom of floor or both surfaces of wall assembly.

**RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE  
HYDROFLAME** — HydroFlame 200

B. **Firestop Device\*** — Steel collar lined with an intumescent material sized to fit specific diam of the through penetrant. Device to be installed around through penetrant in accordance with accompanying installation instructions. Device incorporates anchor tabs for attachment to both surfaces of the wall or bottom surface of floor with 1/4 in. (6 mm) diam by 1-1/4 in. (32 mm) long steel anchors.

**RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE  
HYDROFLAME** — HydroFlame Pipe Collar

C. **Fill, Void or Cavity Material\* - Wrap Strip** — (Not Shown) - As an alternate to Item 3B when max 2 in. (51 mm) diam pipe is used, single layer of nom 1/4 in. (6 mm) thick by 1 in. (25 mm) wide intumescent wrap strip wrapped around the outer circumference of the pipe on bottom of floor or on each side of the wall. Wrap strip installed with butted seam and such that edge of wrap strip is flush with the surface of floor or wall. Wrap strip temporarily secured with tape or tie wire.

**RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE  
HYDROFLAME** — HydroFlame Wrap Strip

D. **Steel Collar** — (Not Shown) - When Item 3C is used, a collar fabricated from coils of precut min 0.016 in. thick (0.41 mm) galv steel available from fill material manufacturer shall be installed to restrain wrap strip. Collar shall be nom 1 in. (25 mm) deep with 1 in. (25 mm) wide by 1-1/2 in. (38 mm) long anchor tabs for attachment to wall. In addition, collar provided with 1/2 in. (13 mm) wide by 3/4 in. (19 mm) long retainer tabs opposite the anchor tabs. Collar shall be wrapped over the wrap strip, overlapping min 1 in. (25 mm). The retainer tabs are folded 90 deg towards the pipe to maintain the

annular space around the pipe and to retain the wrap strip. Collar secured to bottom surface of floor or both surfaces of wall at each anchor tab by means of 1/4 in. (6 mm) diam by 1-1/4 in. (32 mm) long steel anchors in conjunction with 1/4 in. (6 mm) by 5/8 in. (16 mm) diam steel washers.

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2019-01-08

---

### **Design/System/Construction/Assembly Usage Disclaimer**

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

---

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".