

XHEZ.C-AJ-8298 - THROUGH-PENETRATION FIRESTOP SYSTEMS

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada

See General Information for Through-penetration Firestop Systems

See General Information for Through-penetration Firestop Systems Certified for Canada


System No. C-AJ-8298

April 23, 2019

ANSI/UL1479 (ASTM E814)

CAN/ULC S115

F Rating - 2 Hr	F Rating - 2 Hr
T Rating - 0 Hr	FT Rating - 0 Hr
L Rating At Ambient — Less Than 1 CFM/ft ²	FH Rating - 2 Hr
L Rating At 400°F — Less Than 1 CFM/ft ²	FTH Rating - 0 Hr
W Rating - Class 1 (See Items 2, 3C and 4)	L Rating At Ambient - Less Than 5.1 L/s/m ²
	L Rating At 204°C - Less Than 5.1 L/s/m ²

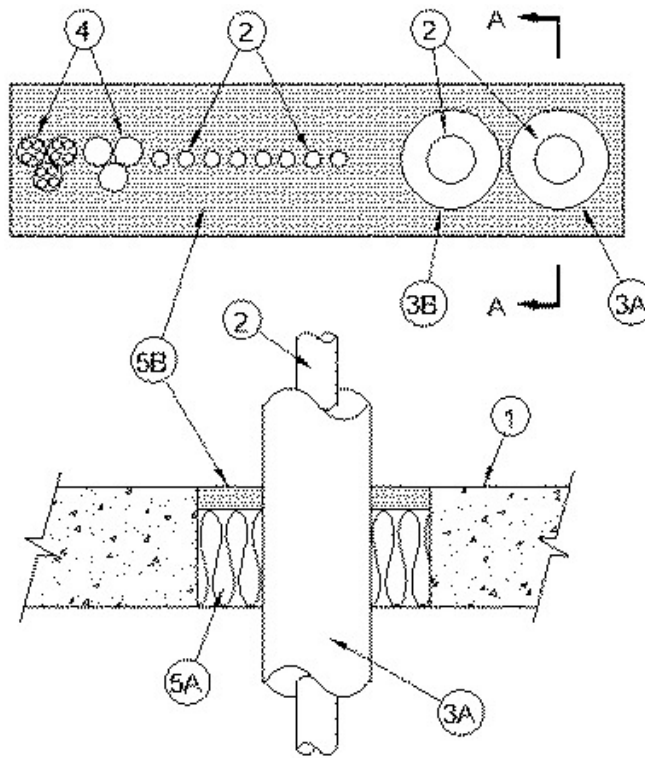

SECTION 'A-A'

1. **Floor or Wall Assembly** — Min 2-1/2 in. (64 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m³) concrete floor, or min 3 in. (76 mm) thick reinforced lightweight or normal concrete wall. Wall may also be constructed of any UL classified **Concrete Blocks***. Max area of opening is 144 sq in. (929 cm²) with max dimension of 24 in. (610 mm).

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

1A. **Steel Deck/Floor Assembly (not shown)** — As an alternate to Item 1, the floor assembly may consist of a fluted steel deck/concrete floor assembly. The floor assembly shall be constructed of the materials and in the manner described in the individual Floor-Ceiling Design in the UL Fire Resistance Directory and shall include the following construction features:

A. **Steel Floor and Form Units*** — 1-1/2 to 3 in. (38 to 76 mm) deep galv fluted units.

B. **Concrete** — Min 2-1/2 in. (64 mm) thick reinforced concrete, as measured from the top plane of the floor units.

2. **Through-Penetrants** — Max ten pipes, conduits or tubing to be installed within the opening. The space between pipes, conduits or tubing shall be a min 3/8 in. (10 mm) to max 1 in. (25 mm). The space between pipes, conduits or tubing and periphery of opening shall be min 1/2 in. to max 3 in. When W Rating applies, annular space is min 1/2 in. (13 mm) to max 1-3/4 in. (44 mm). Pipe, conduit or tubing to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of pipes, conduits or tubing may be used:

A. Max eight steel or iron or Type L copper pipe, tubing or conduit of nom 3/4 in. (19 mm) diam.

B. Max two steel or iron or Type L copper pipe, tubing or conduit of nom 2 in. (51 mm) diam (or smaller).

3. Either or both of the following types of pipe coverings may be used on two of the metallic pipes or tubing having a nom diam of 2 in. (51 mm) or less.

A. **Tube Insulation - Plastics+** — Nom 1 in. (25 mm) thick acrylonitrile butadiene/polyvinyl chloride (AB/PVC) flexible foam furnished in the form of tubing. The insulated pipe or tubing shall be spaced a nom 1-1/4 in. (32 mm) from the other through-penetrants. The annular space between the insulated pipe or tubing and periphery of the opening shall be a min of 1/2 in. (13 mm) to max 1-3/4 in. (44 mm).

See **Plastics+** (QMFZ2) category in the Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5 VA may be used.

B. **Pipe and Equipment Covering Materials** — Nom 1 in. (25 mm) thick hollow cylindrical glass fiber units, nom 3.5 pcf (56 kg/m³), jacketed on the outside with an all service jacket. Longitudinal joints sealed with metal fasteners or factory-applied self-sealing lap tape. Transverse joints secured with metal fasteners or with butt tape supplied with the product. The insulated pipe or tubing shall be spaced a nom 1-1/4 in. (32 mm) from the other through-penetrants. The annular space between the insulated pipe or tubing and periphery of the opening shall be a min of 1/2 in. (13 mm) to max 1-3/4 in. (44 mm). See **Pipe and Equipment Covering Materials** (BRGU) category in the Building Materials Directory for names of manufacturers. Any pipe covering material meeting the above specifications and bearing the UL Classification Marking with a Flame Spread Index of 25 or less and a Smoke Developed Index of 50 or less may be used.

C. **PVC Jacket+** — (Optional) An additional PVC jacketing, supplied in sheet form, shall be tightly wrapped around the all service jacket on the pipe covering, Item 3B, with the longitudinal seam continuously sealed using the adhesive supplied with the jacket. The jacket is to be nom 48 in. (1219 mm) wide by nom 20 or 30 mil (0.5 or 0.8 mm) thick. The jacket shall be installed at a point 36 in. (914 mm) to 40 in. (1016 mm) above the top surface of the floor assembly and shall extend downward into and/or through the opening.

See **Plastics** (QMFZ2) category in the Plastics Recognized Component Directory for names of manufacturers. Any Recognized Component tube insulation material meeting the above specifications and having a UL 94 Flammability Classification of 94-5VA may be used.

The PVC jacket is required for all fiberglass pipe coverings for the W Rating to apply.

4. **Cables** — Max two cable bundles to be installed within the opening. Each bundle to consist of 3 cable lengths of cables specified below. Cable to be tightly bundled and supported on both sides of floor or wall. The annular space between cable bundles and periphery of the opening shall be min 3/8 in. (10 mm) to max 2-5/8 in. (67 mm). **When W Rating applies, the min separation between the individual cables is equal to or greater than 1/8 in. (3 mm) and max of 1-3/4 in. (44 mm).**

A. Max 400 pair No. 24 AWG (or smaller) telephone cables with PVC insulation and jacket.

B. Max 3/C, No. 2/0 AWG (or smaller) copper conductor, PVC jacketed aluminum clad or steel clad cable.

5. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — Min 2 in. (51 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or both surfaces of wall to accommodate the required thickness of fill material.

B. **Fill, Void or Cavity Material*—Sealant** — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus, flush with top surface of floor and both surfaces of wall. Fill material to be forced into interstices of cable group to max extent possible.

RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE HYDROFLAME — HydroFlame 100

+Bearing the UL Recognized Component Mark.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2019-04-23

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC"