

THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

Search Parameters

Manufacturer

Holdrite

XHEZ - Through-penetration Firestop Systems


See General Information for Through-penetration Firestop Systems

System No. C-AJ-2856

January 17, 2019

F Rating — 3 Hr

T Rating — 3 Hr

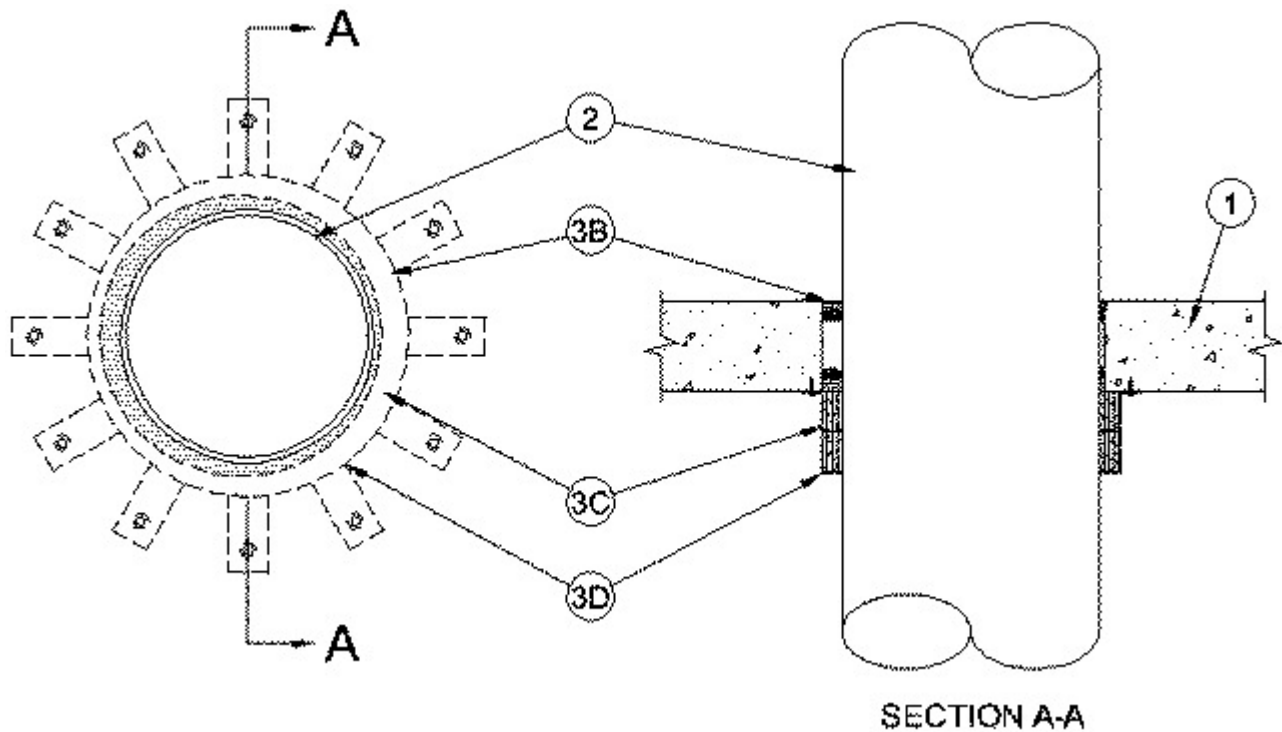

System tested with a pressure differential of 2.5 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed side.

1. **Floor or Wall Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf) (1600-2400 kg/m³) concrete. Wall may also be constructed of any UL Classified **Concrete Blocks***. Max diam of opening is 14 in. (356 mm).

See **Concrete Blocks** (CAZT) category in the Fire Resistance Directory for names of manufacturers.

2. **Through Penetrants** — One non-metallic pipe to be installed either eccentrically or concentrically within the firestop system with an annular space of min 1/4 in. (6 mm) to max 1 in. (25 mm). Pipe to be rigidly supported on both sides of floor or wall assembly. The following types and sizes of non-metallic pipe may be used:

A. **Polyvinyl Chloride (PVC) Pipe** — Nom 10 or 12 in. (254 or 305 mm) diam Sch 40 solid core polyvinyl chloride (PVC) pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

3. **Firestop System** — The firestop system shall consist of the following:

A. **Packing Material** — Foam backer rod firmly packed into opening as a permanent form. Packing material to be recessed from top surface of floor or both surfaces of wall as required to accommodate the required thickness of fill material.

B. **Fill, Void or Cavity Material*—Caulk** — Min 1/2 in. (13 mm) thickness of fill material applied within the annulus, flush with both surfaces of floor or both surfaces of wall.

RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE HYDROFLAME — HydroFlame 200

C. **Fill, Void or Cavity Material* - Wrap Strip** — Nom 1/4 in. (6 mm) thick by 2 in. (51 mm) wide intumescent wrap strip faced on one side with a plastic film. Alternately, two nom 1/4 in. (6 mm) thick by 1 in. (25 mm) wide wrap strips may be butted together side by side to achieve the 2 in. (51 mm) width. Two stacks of four layers of 2 in. (51 mm) wide wrap strip are individually wrapped around the through-penetrant with film exposed and ends butted and held in place with masking tape. Butted ends in successive layers shall be offset. Wrap strip butted tightly against bottom surface of floor or both surfaces of wall.

RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE HYDROFLAME — HydroFlame Wrap Strip

D. **Steel Collar** — Collar fabricated from coils of precut min 0.016 in. (1.59 mm) thick (No. 28 gauge) galv steel available from fill material manufacturer. Collar shall be nom 2 in. (51 mm) deep with 1 in. (25 mm) wide by 1-1/4 in. (32 mm) long anchor tabs on 4 in.

(102 mm) centers for securement to the underside of floor or both surfaces of wall. In addition, collar contains retainer tabs 1/2 in. (13 mm) wide by 3/4 in. (19 mm) long, located opposite the anchor tabs. Collar shall be wrapped over the wrap strip, with ends overlapping min 1 in. (25 mm). The retainer tabs are folded 90 deg towards the pipe to maintain the annular space around the pipe and to retain the wrap strip. Steel collar tightened around wrap strips and through pentetrant using min 1/2 in. (13 mm) wide by 0.028 in. (.71 mm) thick stainless steel hose clamp installed at midheight of the collar. Collar secured to bottom surface of the floor or both surfaces of wall at each anchor tab by means of min 1/4 in. (6 mm) diam. by 1-1/4 in. (32 mm) long steel expansion bolts or steel Tapcon® concrete anchors in conjunction with 1/4 in. (6 mm) by 5/8 in. (16 mm) diam. washers spaced 4 in. (102 mm) OC. A second similar collar with wrap strips shall be installed in a like manner and butted tightly to the first collar. The anchor tabs of the lower collar are left unbent so they may mount to the outside surface of the upper collar using 1/4 sheet metal screws at each anchor tab. A second min 1/2 in. (13 mm) wide by 0.028 in. (.71 mm) thick stainless steel hose clamp shall be installed around the second collar.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2019-01-17

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".

UL and the UL logo are trademarks of UL LLC © 2019 All Rights Reserved.