

# THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

## Search Parameters

Manufacturer

Holdrite

## XHEZ - Through-penetration Firestop Systems

### XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

### System No. F-A-2222

October 29, 2018

<b>ANSI/UL1479 (ASTM E814)</b>	<b>CAN/ULC S115</b>
F Rating - 2 and 3 Hr (See Item 3)	F Rating - 2 and 3 Hr (See Item 3)
T Rating - 0 and 3 Hr (See Item 3)	FT Rating - 0 and 3 Hr (See Item 3)
L Rating At Ambient - Less Than 1 CFM/sq ft	FH Rating - 2 and 3 Hr (See Item 3)
L Rating At 400 F - Less Than 1 CFM/sq ft	FTH Rating - 0 and 3 Hr (See Item 3)
W Rating — Class 1 (See Item 5)	L Rating At Ambient - Less Than 1 CFM/sq ft
	L Rating At 400 F - Less Than 1 CFM/sq ft

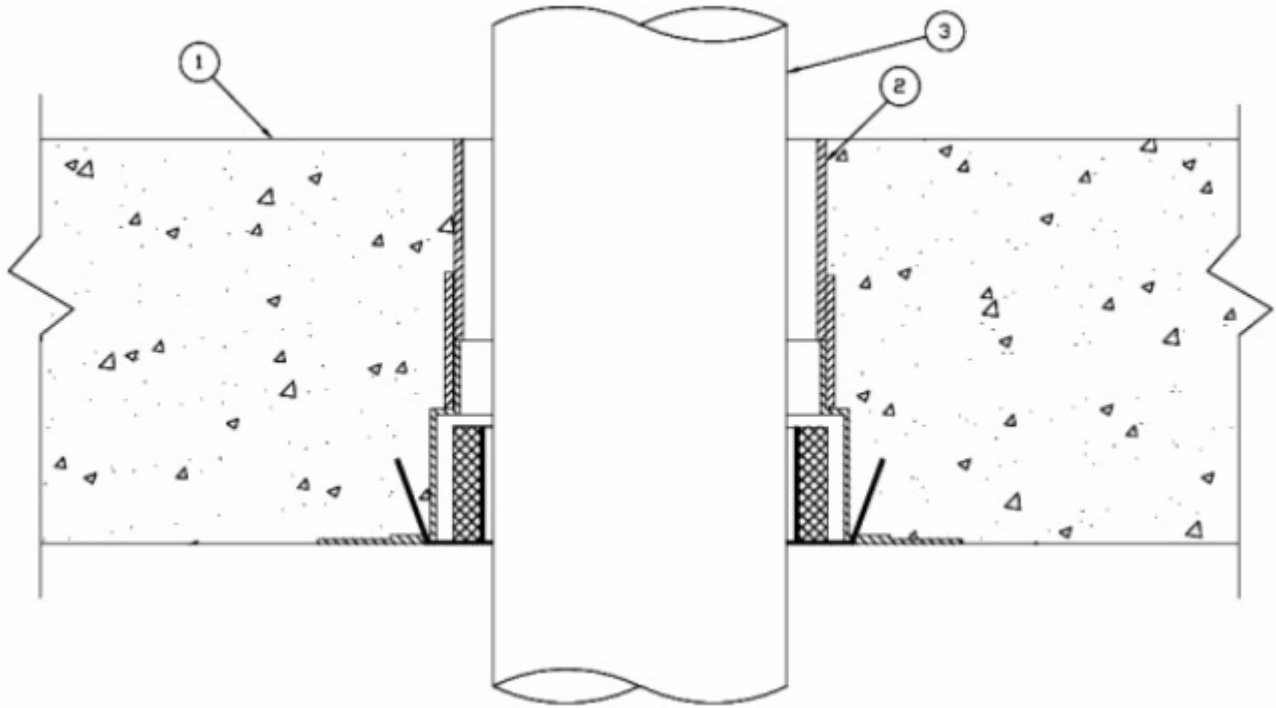

System tested with a pressure differential of 50 Pa between the exposed and the unexposed surfaces with the higher pressure on the exposed.

1. **Floor Assembly** — Min 4-1/2 in. (114 mm) thick reinforced lightweight or normal weight (100-150 pcf or 1600-2400 kg/m<sup>3</sup>) concrete.
2. **Firestop Device\*** — Cast in place firestop device permanently embedded during concrete placement in accordance with accompanying installation instructions. The device shall be installed flush with top and bottom surfaces of floor. The devices are sized to accommodate the following nom pipe sizes:

Nom Pipe Diam in. (mm)	Firestop Device
1/2 to 1 (13 to 25)	WD-PL-0200
1-1/4 to 2 (32 to 51)	WD-PL-0300
2-1/2 to 3 (64 to 76)	WD-PL-0400
3 to 4 (76 to 102)	WD-PL-0500
5 to 6 (127 to 152)	WD-PL-0800

**HOLDRITE** — HydroFlame WD-PL

3. **Through Penetrant** — One nonmetallic pipe or conduit to be installed within the firestop device. Pipe or conduit to be installed in accordance with firestop device installation instructions and rigidly supported on both sides of floor assembly. The following types of pipe, conduit or tubing may be used:

**A. Polyvinyl Chloride (PVC) Pipe** — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 solid or cellular core PVC pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems.

**A1. Polyvinyl Chloride (PVC) Pipe** — As an alternate to Item A, Nom 6 in. (152 mm) diam (or smaller) solid or cellular core Schedule 40 polyvinyl chloride (PVC) pipe.  
**IPEX INC** — System 15 piping

**When nom 5 in. or 6 in. (127 or 152 mm) diam PVC pipe is used, F Rating is 2 hr and T Rating is 0 hr. When max 4 in. (102 mm) diam PVC pipe is used, F Rating is 3 hr and T Rating is 3 hr.**

**B. Rigid Nonmetallic Conduit+** — Nom 6 in. (152 mm) diam (or smaller) Schedule 40 PVC conduit installed in accordance with the National Electrical Code (NFPA No. 70). **When nom 5 in. or 6 in. (127 or 152 mm) diam PVC conduit is used, F Rating is 2 hr and T Rating is 0 hr. When max 4 in. (102 mm) diam PVC conduit is used, F Rating is 3 hr and T Rating is 3 hr.**

**C. Chlorinated Polyvinyl Chloride (CPVC) Pipe** — Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 (or heavier) or Schedule 40 CPVC pipe for use in closed (process or supply) piping systems.

**C1. Chlorinated Polyvinyl Chloride (CPVC) Pipe** — As an alternate to Item C, Nom 6 in. (152 mm) diam (or smaller) SDR 13.5 CPVC for use in closed (process or supply) piping systems.  
**IPEX INC** — AquaRise

**When nom 5 in. or 6 in. (127 or 152 mm) diam CPVC pipe is used, F Rating is 2 hr and T Rating is 0 hr. When max 4 in. (102 mm) diam CPVC pipe is used, F Rating is 3 hr and T Rating is 3 hr.**

**D. Acrylonitrile Butadiene Styrene (ABS) Pipe** — Nom 4 in. (102 mm) diam (or smaller) Schedule 40 solid or cellular core ABS pipe for use in closed (process or supply) or vented (drain, waste or vent) piping systems. **When max 4 in. (102 mm) diam ABS pipe is used, F Rating is 3 hr and T Rating is 3 hr.**

**E. Cross-Linked Polyethylene (PEX) Tubing** — Nom 2 in. (51 mm) diam (or smaller) SDR 9 PEX tubing for use in closed (process or supply) piping systems. **When max 2 in. (51 mm) diam ABS pipe is used, F Rating is 3 hr and T Rating is 3 hr.**

**4. Packing Material** — (Optional. Not Shown) - Min 2 in. (51 mm) depth of min 4 pcf (64 kg/m<sup>3</sup>) mineral wool batt insulation tightly-packed into annular space between penetrant and device with its top surface flush with the top surface of the floor. When

optional sealant (Item 5) is used, top surface of packing material to be recessed min 1/4 in. (6 mm) from top surface of floor.

**5. Fill, Void or Cavity Material\* - Sealant** — (Optional, Not Shown) - Min 1/4 in. (6 mm) thickness of sealant applied within the annulus, flush with the top surface of floor. Sealant to lap min 1/2 in. (13 mm) onto top surface of concrete around perimeter of firestop device. **W Rating applies only when packing material (Item 4) and sealant is used.**

**3M COMPANY 3M FIRE PROTECTION PRODUCTS** — FB-1000 NS, FB-3000 WT or FB-1003 SL

**\* Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2018-10-29

---

### **Design/System/Construction/Assembly Usage Disclaimer**

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

---

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".

