

THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

Search Parameters

Manufacturer

Holdrite

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

System No. W-L-3452

February 01, 2019

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings - 1 and 2 Hr (See Item 1)	F Ratings -1 and 2 Hr (See Item 1)
	FH Ratings -1 and 2 Hr (See Item 1)
T Ratings - 1, 1-1/4 and 2 Hr (See Item 5)	FT Ratings - 1, 1-1/4 and 2 Hr (See Item 5)
	FTH Ratings -1, 1-1/4 and 2 Hr (See Item 5)

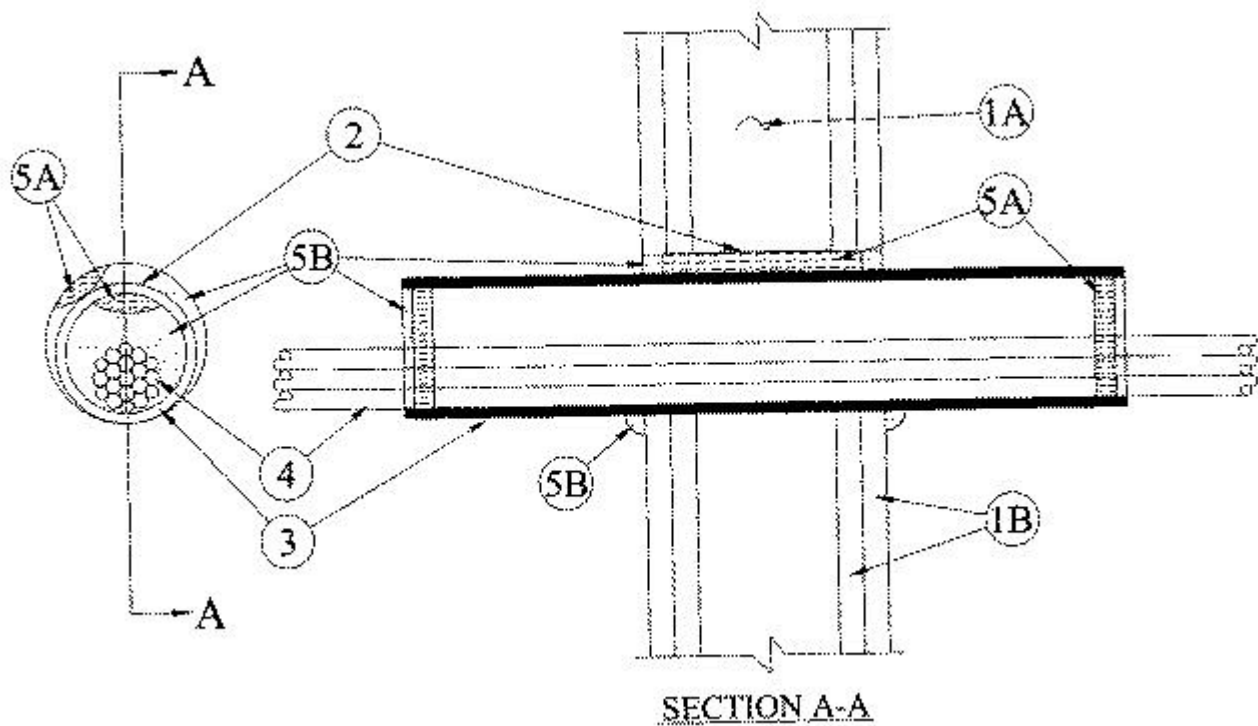

1. **Wall Assembly** — The 1 or 2 hr fire-rated gypsum wallboard/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300 or U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features:

A. **Studs** — Wall framing shall consist of either wood or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 3-1/2 in. (89 mm) wide and spaced max 24 in. (610 mm) OC.

B. **Gypsum Board*** — Min 5/8 in. (16 mm) thick, 4 ft (1.2 m) wide with square or tapered edges. The gypsum wallboard type, thickness, number of layers and orientation shall be as specified in the individual U300 or U400 Wall and Partition Design. Max diam of opening is 4 in. (102 mm)

The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. **Steel Wire Mesh** — Cylindrical sleeve fabricated from No. 8 steel wire mesh and having a min 2 in. (51 mm) lap along the longitudinal seam. Length of steel mesh to be 1/2 in. (13 mm) less than thickness of wall. Steel wire mesh to be centered and formed to fit periphery of through opening.

3. **Nonmetallic Sleeve** — Nom 3 in. (76 mm) diam. (or smaller) Schedule 40 solid core polyvinyl chloride pipe. Sleeve installed to project 6 in. (152 mm) beyond each surface of wall. The annular space between nonmetallic sleeve and periphery of opening shall be min 0 in. (0 mm) (point contact) to max 1/2 in. (13 mm)

4. **Cables** — Aggregate cross-sectional area of bundled cables to be max 24 percent of the cross-sectional area within the nonmetallic sleeve (Item 3). Cables to

be rigidly supported on both sides of wall assembly. Any combination of the following types and sizes of copper conductor cables may be used:

A. Max 25 pr No. 24 AWG telephone cables with polyvinyl chloride (PVC) insulation and jacket.

B. Max 4 pr No. 24 AWG telephone cables with PVC insulation and jacket.

C. Max 2/C with ground No. 12 AWG Type NM nonmetallic sheathed (Romex) cable with PVC insulation and jacket.

D. Max 4 pr No. 24 AWG category 5 computer cables.

5. Firestop System — The firestop system shall consist of the following:

A. **Packing Material** — Min 3-3/4 (95 mm) or 5 in. (127 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation firmly packed into opening around outside of sleeve as a permanent form for 1 or 2 hr rated wall, respectively. Min 1 in. (25 mm) thickness of min 4 pcf (64 kg/m³) mineral wool batt insulation also packed within each end of nonmetallic sleeve around cable bundle as a permanent form. Packing material to be recessed from both surfaces of wall and ends of sleeve as required to accommodate the required thickness of fill material.

B. **Fill, Void or Cavity Materials* — Caulk** — Min 1/2 in. (13 mm) thickness of fill material applied within annulus around outside of sleeve, flush with both surfaces of wall. Min 1/4 in. (6 mm) thickness of fill material also applied within each end of nonmetallic sleeve around cable bundle, flush with end of sleeve. At point contact locations, a min 1/4 in. (6 mm) diam. bead of fill material shall be applied to the wall/nonmetallic sleeve and nonmetallic sleeve/cable interfaces on both sides of wall.

**RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE
HYDROFLAME** — HydroFlame 200

C. **Packing Material** — (Not Shown) — As an alternate to the steel wire mesh (Item 2) and the mineral wool batt insulation (Item 5A), foam backer rod may be packed into the opening around outside of sleeve and within each end of nonmetallic sleeve around cable bundle as a permanent form. Packing material to be recessed from both surfaces of wall and ends of sleeve as required to accommodate the required thickness of fill material. In 1 hr fire rated wall assemblies, steel wire mesh (Item 2) and mineral wool batt insulation (Item 5A), along with foam backer rod around outside of the sleeve, may all be omitted. **When foam backer rod is used in 2 hr fire rated wall assemblies, the T Rating is 1-1/4 hr. When the steel wire mesh and mineral wool batt insulation**

**are used in 2 hr fire rated wall assemblies, the T Rating is 2 hr.
In all cases, in 1 hr fire rated wall assemblies, T Rating is 1 hr.**

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2019-02-01

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".

UL and the UL logo are trademarks of UL LLC © 2019 All Rights Reserved.