

THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

Search Parameters

Manufacturer

Holdrite

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

System No. W-L-3453

February 01, 2019

ANSI/UL1479 (ASTM E814)	CAN/ULC S115
F Ratings — 1 and 2 Hr (See Item 1)	F Ratings — 1 and 2 Hr (See Item 1)
T Rating — 0 Hr	FT Rating — 0 Hr
L Rating At Ambient — Less Than 1 CFM/sq ft	FH Ratings — 1 and 2 Hr (See Item 1)
L Rating At 400°F — 1.4 CFM/sq ft	FTH Rating — 0 Hr
	L Rating At Ambient — Less Than 1 CFM/sq ft
	L Rating At 400°F — 1.4 CFM/sq ft

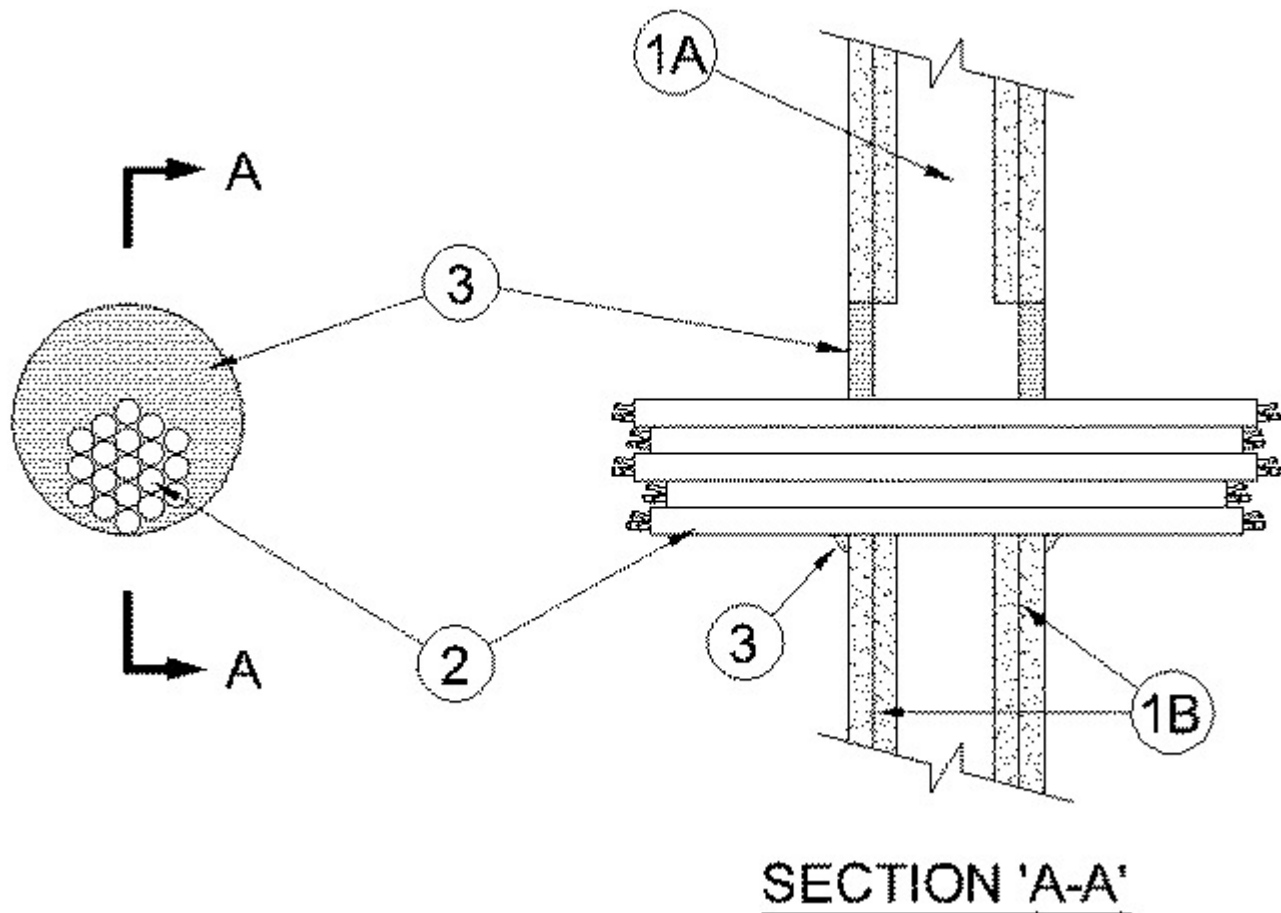

SECTION 'A-A'

1. Wall Assembly — The 1 or 2 hr fire rated gypsum board/stud wall assembly shall be constructed of the materials and in the manner specified in the individual U300, U400, V400 or W400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall include the following construction features.

A. Studs — Wall framing may consist of either wood studs or steel channel studs. Wood studs to consist of nom 2 by 4 in. (51 by 102 mm) lumber spaced 16 in. (406 mm) OC. Steel studs to be min 3-5/8 in. (92 mm) wide and spaced max 24 in. (610 mm) OC.

B. Gypsum Board* — Min 5/8 in. (16 mm) thick, 4 ft (1.22 m) wide with square or tapered edges. Thickness, type, number of layers and fasteners as required in the individual Wall and Partition Design. Max diam of opening is 4 in. (102 mm).

The hourly F and FHRatings of the firestop system are equal to the hourly fire rating of the wall assembly in which it is installed.

2. Cables — Max 2-3/4 in. (70 mm) diam tight bundle of cables to be installed either concentrically or eccentrically within the opening. Aggregate cross-sectional area of cables in opening to be max 41 percent of the cross-sectional area of the opening. The annular space between the cable bundle and the periphery of opening shall be min 0 in. (0 mm, point contact) to max 1-1/4 in. (32 mm). Any combination of the following types and sizes of cables may be used:

A. Max 3/C with ground No. 12 AWG (or smaller) copper conductor cable (12-3 Romex) with polyvinyl chloride (PVC) insulation and

jacket.

B. Max RG/6 No. 18 AWG Type CATV copper conductor coaxial cable with PVC insulation and jacket.

C. Max 1/C - 350 kcmil (or smaller) cable with PVC or cross-linked polyethylene (XLPE) insulation and jacket.

D. Max 400 pair No. 24 AWG copper telephone cables, with PVC insulation and jacket.

E. Max 1/C - 350 kcmil (or smaller) cable with XLPE insulation and jacket.

F. Max 4/C - No. 2/0 (or smaller) aluminum or copper conductor, aluminum or steel jacketed Metal-Clad or Armored-Clad Cable.+

G. Max 3/C (with ground) No. 2/0 AWG aluminum conductor service entrance cable with PVC insulation and jacket.

H. Max 24 fiber 62.5/125 fiber optic cable with PVC insulation and jacket.

3. Fill, Void, or Cavity Materials* - Sealant — Min 5/8 in. (16 mm) thickness of fill material applied within the annulus, flush with each surface of wall. The sealant is also applied to fill all the interstices between the cables, prior to securing the bundle together, at both surfaces of wall. Additional sealant to be applied such that a min 3/8 in. (10 mm) bead is formed, at the point of contact of cable bundle and wall, on both surfaces of wall.

RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE HYDROFLAME — HydroFlame 200

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

+Bearing the UL Listing Mark

Last Updated on 2019-02-01

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.

- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".

UL and the UL logo are trademarks of UL LLC © 2019 All Rights Reserved.