

THROUGH-PENETRATION FIRESTOP SYSTEM

Assembly Usage Disclaimer

Search Parameters

Manufacturer

Holdrite

XHEZ - Through-penetration Firestop Systems

XHEZ7 - Through-penetration Firestop Systems Certified for Canada


[See General Information for Through-penetration Firestop Systems](#)

[See General Information for Through-penetration Firestop Systems Certified for Canada](#)

System No. W-L-7288

February 14, 2019

ANSI/UL1479 (ASTM E814)	CAN/ULC S115	
F Ratings - 1 and 2 Hr (See Item 1)	F Ratings -1 and 2 Hr (See Item 1)	
	FH Ratings -1 and 2 Hr (See Item 1)	
T Rating - 1/4 Hr	FT Rating - 1/4 Hr	
	FTH Rating -1/4 Hr	

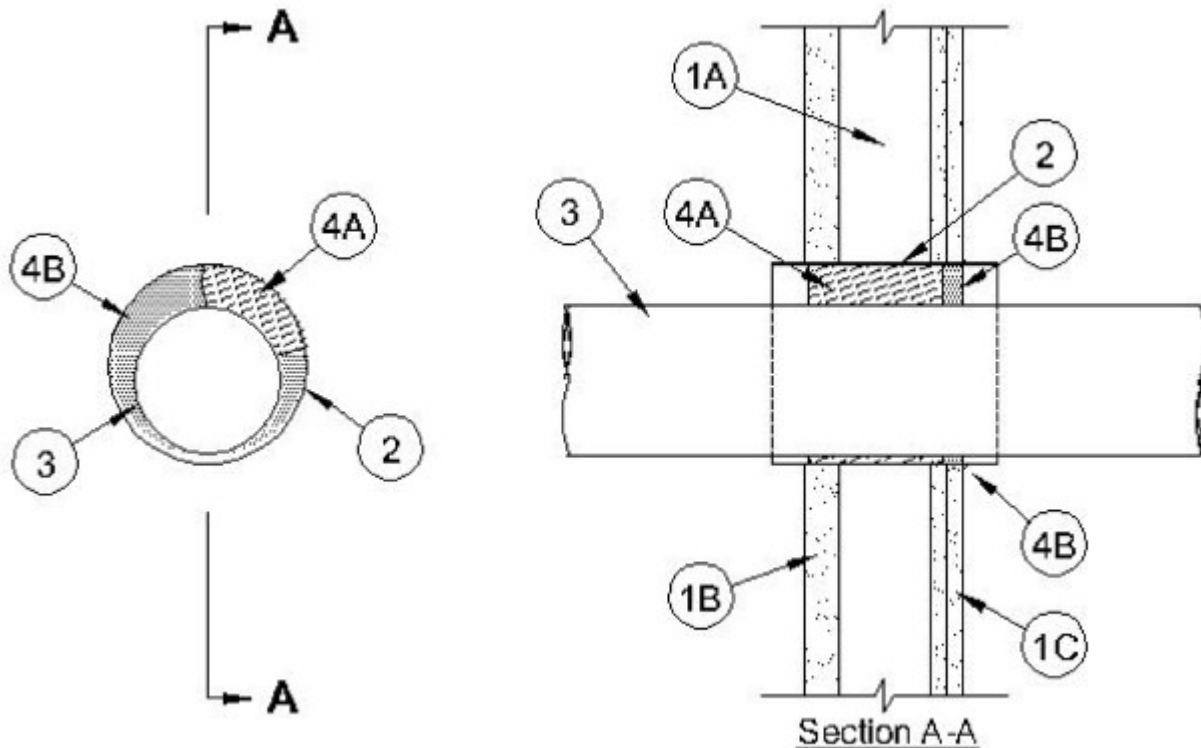

1. **Wall Assembly** — The 1 or 2 hr fire-rated gypsum board/stud shaft wall assembly shall be constructed of the materials and in the manner specified in the individual U400 Series Wall and Partition Designs in the UL Fire Resistance Directory and shall incorporate the following construction features:

A. **Steel Studs** — "C-H" or "C-T" shaped studs, min 2-1/2 in. (64 mm) wide by 1-1/2 in. (38 mm) deep, fabricated from min No. 25 gauge (0.6 mm thick) galv steel, spaced max 24 in. (610 mm) OC.

B. **Gypsum Board*** — 1 in. (25 mm) thick, 24 in. (610 mm) wide gypsum liner panels installed vertically.

C. **Gypsum Board*** — 1/2 in. or 5/8 in. (13 or 16 mm) thick, 48 in. (1.2 m) wide gypsum boards. The gypsum board type, thickness, number of layers, fastener type and sheet orientation shall be as specified in the individual Wall and Partition Design.

The hourly F Rating of the firestop system is equal to the hourly fire rating of the wall assembly in which it is installed.

2. **Steel Sleeve** — Sleeve fabricated from min No. 28 gauge galv steel vent duct. Steel sleeve to extend 1 in. (25 mm) from the surface of wall, with sleeve centered and formed to fit periphery of through opening.

3. **Steel Duct** — One nom 8 by 8 in. (203 by 203 mm) (or smaller) or one nom 12 in. (305 mm) min No. 28 gauge galv steel vent duct to be installed either concentrically or eccentrically within the firestop system. The annular space between the vent duct and the sleeve of the opening shall be min 1/4 in. to max 1-1/4 in. (6 to 32 mm). Steel vent duct to be rigidly supported on both sides of the wall assembly.

4. Firestop System — The firestop system consists of the following items:

A. Forming Material — Min 4 pcf (64 kg/m³) mineral wool batt insulation compression fit between the sleeve and duct as a permanent form within the sleeve. The thickness of the mineral wool is to be min 4 in. (102 mm) installed from the finished side of the wall to a depth to accommodate the depth of sealant required.

B. Fill, Void or Cavity Material* - Sealant — Fill material thickness installed to 5/8 in. (16 mm) depth on finished side of wall assembly. A minimum 1/4 in. (6 mm) diameter bead of sealant applied around the perimeter of the steel sleeve.

**RELIANCE WORLDWIDE CORPORATION DBA HOLDRITE
HYDROFLAME** — HydroFlame 100

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2019-02-14

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In

addition, the reprinted material must include a copyright notice in the following format: "© 2019 UL LLC".

UL and the UL logo are trademarks of UL LLC © 2019 All Rights Reserved.